



SINOSTAR

中辰股份



股票代码:300933

66kV

66kV

66 500kV



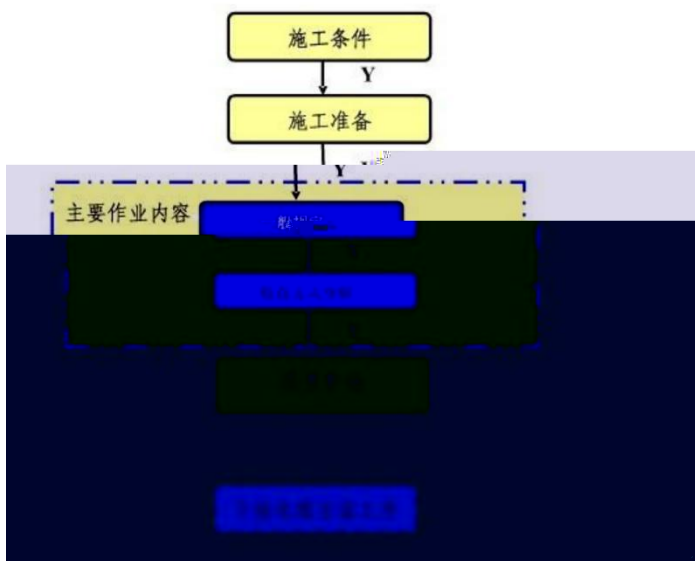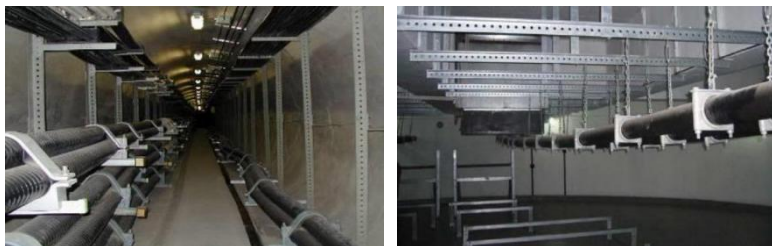

1.

2.

3.

4.

5.

6.

1.



2.


3.

4.

24




5 , 5

5.

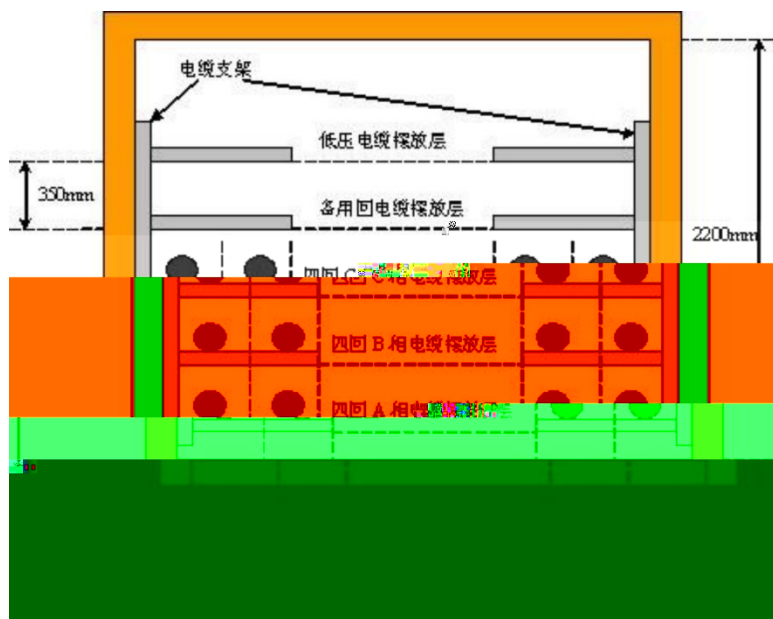


6.

7.

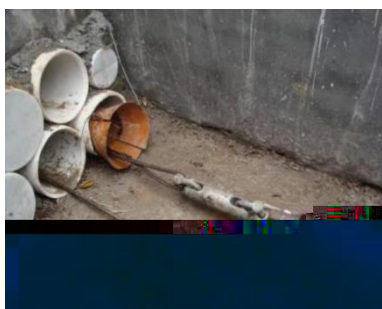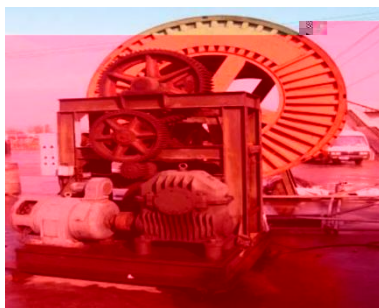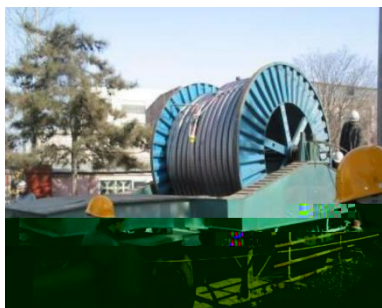


1.

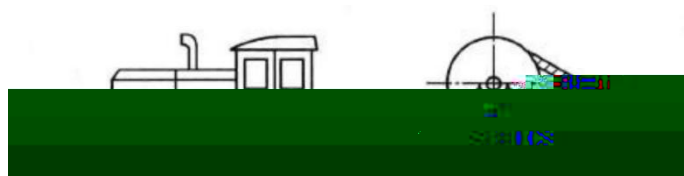


2.

- 输送机启动时，电缆盘应有工协助转动或制动

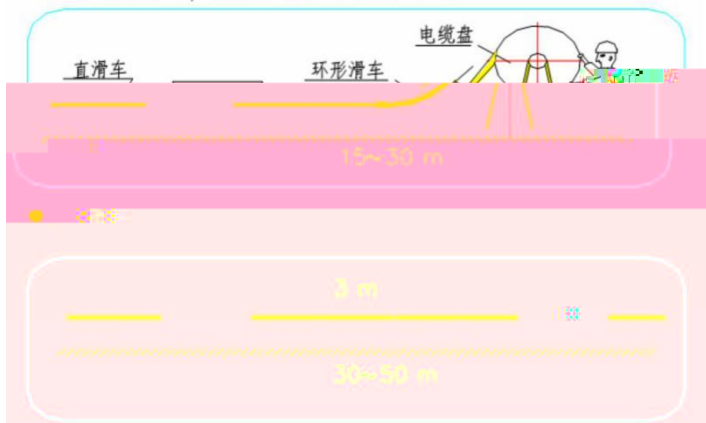


3.

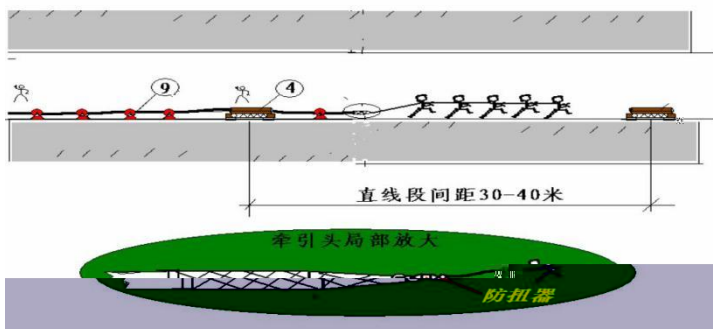


4.


- 电缆转弯时，输送机应布置在直线段部位




- 电缆上坡时，输送机应按下图所示放置

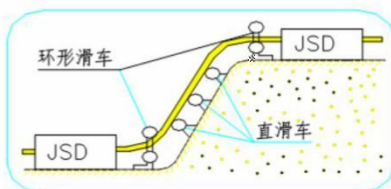

5.

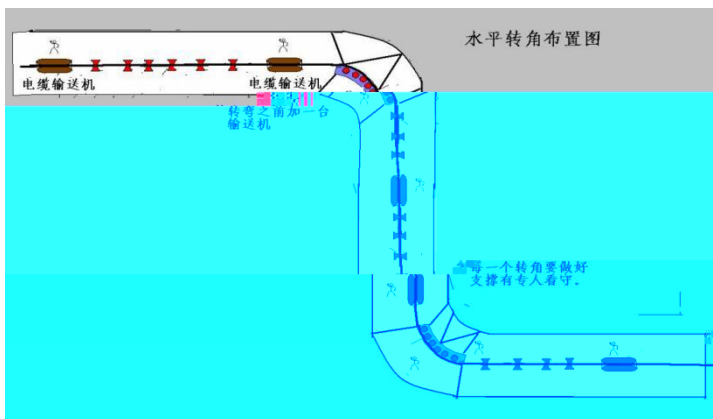

6.

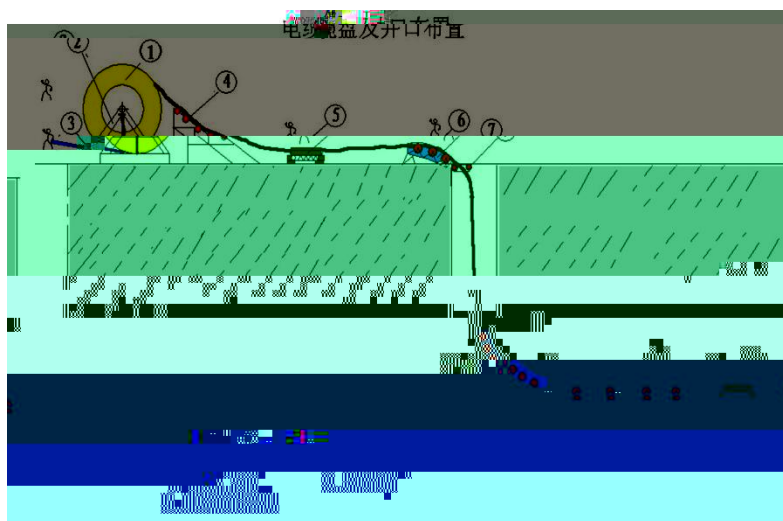

7.



8. 6 10m 3~ 5m

9. S

1.

2.

3.

10m/min

4.

= $\times 50\text{N/mm}^2$

= $\times 30\text{N/mm}^2$

3kN/m

5.

6.

7.

8.

9.

2/3

10.

11.


d :

66kV-150kV	35d	30d	15d	20d
220kV	35d	30d	15d	20d

12.

13.

1.

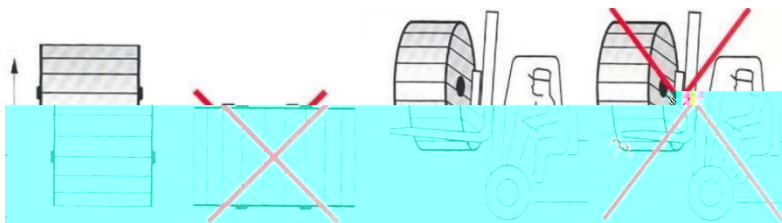

2.

3.

4.

5.

6.

7.

8.

9.